

**1 or 2 Lamp
T5, T5HO, T8, T12,
Slimline or
High Output T8(380mA) or T12(800mA)**

NSF Certified for Non-Food Zone Installations.

APPLICATION

- Acceptable for outdoor as well as indoor installations.
- Can be surface (wall/ceiling) or suspended mounted unless otherwise specified.
- **Wet Location**-Areas of high humidity, water vapor, rain, incidental water spray, or other non-corrosive or non-flammable liquid.
- **Mounting brackets available, order separately.**
- IP67 rating.

CONSTRUCTION/FINISH

- Non-conductive, non-corrosive housing.
- Smooth exterior surface for easy cleaning.
- White molded fiberglass reinforced polyester body.
- High impact DR acrylic molded lens.
- Continuous closed cell, foam in-place gasket.
- ABS cam action latches.
- Lighting channel has high reflectance baked white enamel finish.
- Two gasketed threaded (1/2" trade size) wet location hubs installed on ends.


ELECTRICAL

- Class P, HPF, CBM certified ballasts.
- Electronic ballasts are standard on high output (44HO and 48HO) models, please include EB ballast designator in catalog number. Magnetic HO ballasts are more expensive than electronic and are suitable for cold ambient applications only.
- Day-Brite's standard fixtures for high output T8 (380mA) and T12 (800mA) include ballasts rated for -20° F starting temperature where available.
- Self-contained fluorescent emergency ballasts available: Wet location only, use DEB-7W or DEB-5W
- UL/cUL listed.
- Wet Location UL 1598, also suitable for damp locations.

ACCESSORIES

- **TBK** – Stainless Steel Top Bracket Kit (pair of brackets plus hardware)
- **EBK** – Stainless Steel End Bracket Kit (pair of brackets plus hardware)

CATALOG NUMBER

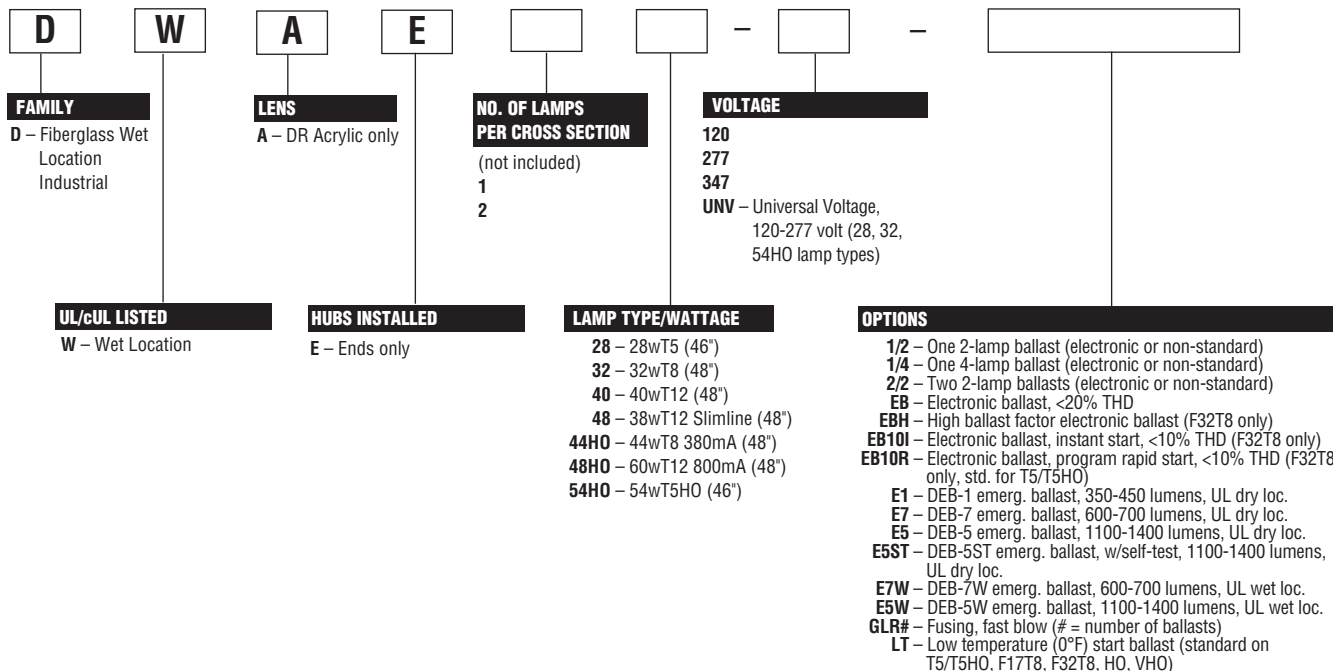

See section 1600-OA for option info.


JOB INFORMATION

1514.4-PF

4' VAPORLUME WET LOCATION INDUSTRIAL





DIMENSIONS

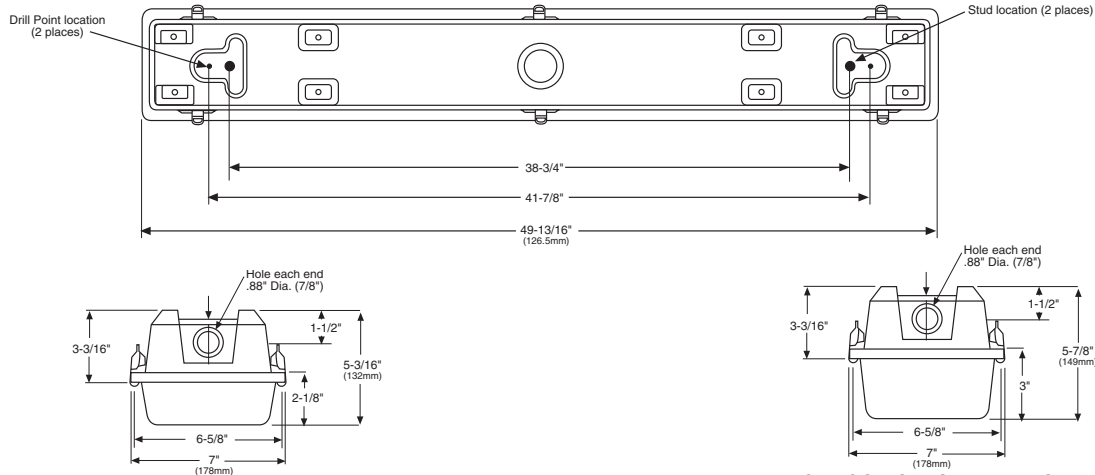


SHALLOW LENS VERSION (STANDARD)

DEEP LENS VERSION FOR HIGH AMBIENT, OR WHEN 800mA LAMPS ARE OPERATED ON MAGNETIC BALLASTS.

MOUNTING BRACKETS

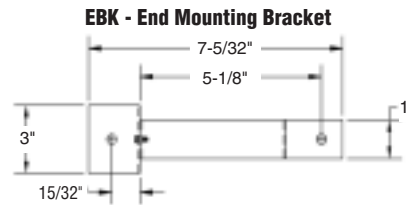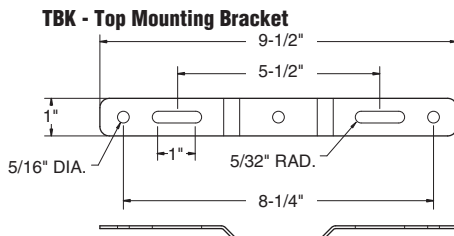

EBK - End Mounting Bracket



PHOTOMETRIC DATA

CATALOG # DWAE232-120-1/2-EB
TEST #20017 S/MH=1.5

LAMPS = F32T8
BALLAST = ELECTRONIC

INPUT WATTS = 54
BALLAST FACTOR = .88

LER = F-79

COMPARATIVE YEARLY LIGHTING ENERGY COST PER 1000 LUMENS = \$3.04 BASED ON 3000 HRS. AND \$.08 PER KWH.

FIXTURE EFFICIENCY = 85.1%

CANDLEPOWER				
Angle	End	45	Cross	
0	1109	1109	1109	
5	1102	1105	1104	
15	1066	1096	1116	
25	988	1063	1117	
35	871	1007	1110	
45	717	921	1065	
55	528	796	973	
65	336	661	867	
75	174	552	739	
85	53	369	511	
95	19	199	323	
105	15	112	190	
115	7	56	83	
125	3	28	39	
135	2	13	23	
145	4	7	13	
155	4	4	6	
165	5	5	7	
175	6	7	8	

MAINTAINED ILLUMINATION TABLE - Square Feet/Fixture*

- 80-50-20 Reflectances (Ceiling-Wall-Floor)
- LLF = 0.75 2850 Lumens/Lamp Clean
- Room width divided by room height = 5 or more, 2 or 1

Fixture Size & # of Lamps	Room Width Room Height =	Approx. Area (sq. ft.) per Fixture				
		10 ft-c	30 ft-c	50 ft-c	70 ft-c	100 ft-c
2-Lamp F32 T8	5	-	119	71	51	36
	2	-	77	46	33	-
	1	-	55	33	-	-

*Observe Fixture S/MH Requirements for Specific Applications

AVERAGE LUMINANCE CD/SQ.M WITH 2850 LUMEN LAMPS

ANGLE	END	45°	CROSS
45	5162	5457	5986
55	4608	5337	6090
65	3872	5287	6339
75	3090	5685	6743
85	2194	5573	6459

TYPICAL V.C.P.'s

Room Size	Mounting Height			
	Lengthwise		Crosswise	
	8.5	10	8.5	10
30x30	30	37	24	30
40x40	26	30	21	25
60x30	31	36	27	33
60x60	24	26	19	21
100x100	22	23	18	19

COEFFICIENT OF UTILIZATION

pfc pcc pw	20			70			50		
	70	50	30	70	50	30	50	30	
RCR									
0	100	100	100	95	95	95	91	91	
1	88	82	78	84	80	76	75	71	
2	79	70	64	76	68	61	64	58	
3	70	60	53	68	58	52	56	48	
4	65	54	45	61	52	44	48	41	
5	58	47	39	56	46	38	42	36	
6	55	42	34	53	40	34	39	32	
7	51	38	29	48	36	29	34	28	
8	46	34	27	45	34	27	32	26	
9	44	32	25	41	30	23	28	23	
10	40	28	22	40	28	22	27	20	

LIGHT DISTRIBUTION

DEGREES	LUMENS	% LAMP	% FIXTURE
0-30	905	15.9	18.7
0-40	1532	26.9	31.6
0-60	2923	51.3	60.3
0-90	4438	77.9	91.5
90-180	412	7.2	8.5
0-180	4850	85.1	100.0

LLF = .75 LLF = LIGHT LOSS FACTOR LLD = LDD X LLD X BF LDD = VERY CLEAN 0.94 CLEAN 0.90 LLD = 0.91 @ 40% RATED LAMP LIFE BF = 0.88 ELECTRONIC BALLAST & T8 LAMP (RELAMP AT 70% LAMP LIFE)

1514.4-PF

DAY-BRITE LIGHTING • www.daybritelighting.com
776 South Green Street • Tupelo, Mississippi 38804 • PH: (662) 842-7212 • FAX: (662) 841-5501
CANADIAN DIVISION
189 Bullock Drive • Markham, Ontario L3P 1W4 • PH: (905) 294-9570 • FAX: (905) 294-9811
©2008 DAY-BRITE LIGHTING DAY-BRITE RESERVES THE RIGHT TO MAKE CHANGES WITHOUT NOTICE.

PHILIPS